



technical data

600x600 4-Way Blow Ceiling Mounted Cassette
FXZQ-M9V1B

air conditioning systems

R-410A



technical data

600x600 4-Way Blow Ceiling Mounted Cassette

FXZQ-M9V1B

air conditioning systems

R-410A

TABLE OF CONTENTS

FXZQ-M9V1B

| | | |
|---|---|----|
| 1 | Specifications | 2 |
| | Technical Specifications | 2 |
| | Electrical Specifications (50Hz) | 3 |
| 2 | Safety device settings | 4 |
| 3 | Options | 4 |
| 4 | Capacity tables | 5 |
| | Cooling capacity tables | 5 |
| | Heating capacity tables | 6 |
| 5 | Dimensional drawing & centre of gravity | 7 |
| | Dimensional drawing | 7 |
| | Centre of gravity | 8 |
| 6 | Piping diagram..... | 9 |
| 7 | Wiring diagram..... | 10 |
| | Wiring diagram | 10 |
| 8 | Sound data..... | 11 |
| | Sound level data | 11 |
| | Sound pressure spectrum | 12 |
| 9 | Air flow pattern..... | 13 |

1 Specifications

| 1-1 TECHNICAL SPECIFICATIONS | | | | FXZQ20M9V1B | FXZQ25M9V1B | FXZQ32M9V1B | FXZQ40M9V1B | FXZQ50M9V1B |
|--|-----------------------------------|--|------------------|------------------|-------------|-------------|-------------|-------------|
| Capacity | Cooling | kW | 2.2 | 2.8 | 3.6 | 4.5 | 5.6 | |
| | Heating | kW | 2.5 | 3.2 | 4.0 | 5.0 | 6.3 | |
| Power Input (50Hz) | Cooling | kW | 0.073 | 0.073 | 0.076 | 0.089 | 0.115 | |
| | Heating | kW | 0.064 | 0.064 | 0.068 | 0.080 | 0.107 | |
| Casing | Material | | Galvanised steel | | | | | |
| Dimensions | Unit | Height | mm | | 286 | | | |
| | | Width | mm | | 575 | | | |
| | | Depth | mm | | 575 | | | |
| Weight | Unit | | kg | | 18 | | | |
| Heat Exchanger | Dimensions | Nr of Rows | | 2 | | | | |
| | | Fin Pitch | mm | | 1.5 | | | |
| | | Face Area | m ² | | 0.269 | | | |
| | | Nr of Stages | | 10 | | | | |
| Fan | Type | | Turbo fan | | | | | |
| | Quantity | | 1 | | | | | |
| Cooling | High | m ³ /min | 9.0 | 9.0 | 9.5 | 11.0 | 14.0 | |
| | Low | m ³ /min | 7.0 | 7.0 | 7.5 | 8.0 | 10.0 | |
| Fan | Motor | Quantity | | 1 | | | | |
| | | Model | | QTS32C15M | | | | |
| | | Output (high) | W | | 55 | | | |
| | | Drive | | Direct drive | | | | |
| Refrigerant | Name | | R-410A | | | | | |
| Sound level | Cooling | Sound power (nominal) | dB(A) | 47 | 47 | 49 | 53 | 58 |
| | | Sound Pressure | High | dB(A) | 30 | 30 | 32 | 36 |
| | Low | | dB(A) | 25 | 25 | 26 | 28 | 33 |
| Piping connections | Liquid (OD) | Type | | Flare connection | | | | |
| | | Diameter | mm | | 6.35 | | | |
| | Gas | Type | | Flare connection | | | | |
| | | Diameter | mm | | 12.7 | | | |
| | Drain | Diameter | | mm | | 26 | | |
| Heat Insulation | | Foamed polystyrene/foamed polyethylene | | | | | | |
| Decoration Panel | Model | | BYFQ60B7W1 | | | | | |
| | Colour | | White (Ral 9010) | | | | | |
| | Dimensions | Height | mm | | 55 | | | |
| | | Width | mm | | 700 | | | |
| | | Depth | mm | | 700 | | | |
| Weight | | kg | | 2.7 | | | | |
| Air Filter | | Resin net with mold resistance | | | | | | |
| Refrigerant control | | Electronic expansion valve | | | | | | |
| Temperature control | | Microprocessor thermostat for cooling and heating | | | | | | |
| Safety devices | | PC board fuse | | | | | | |
| | | Fan motor thermal protector | | | | | | |
| Standard Accessories | Installation and operation manual | | | | | | | |
| | Paper pattern for installation | | | | | | | |
| | Drain hose | | | | | | | |
| | Clamp metal | | | | | | | |
| | Washer fixing plate | | | | | | | |
| | Sealing pads | | | | | | | |
| | Clamps | | | | | | | |
| | Screws | | | | | | | |
| | Washer for hanger bracket | | | | | | | |
| | Insulation for fitting | | | | | | | |
| | Notes | Nominal cooling capacities are based on : indoor temperature : 27°CDB, 19°CWB, outdoor temperature : 35°CDB, equivalent refrigerant piping : 7.5m (horizontal) | | | | | | |
| Nominal heating capacities are based on : indoor temperature : 20°CDB, outdoor temperature : 7°CDB, 6°CWB, equivalent refrigerant piping : 7.5m (horizontal) | | | | | | | | |
| Capacities are net, including a deduction for cooling (an addition for heating) for indoor fan motor heat. | | | | | | | | |

1 Specifications

| 1-2 ELECTRICAL SPECIFICATIONS (50HZ) | | | FXZQ20M9V1B | FXZQ25M9V1B | FXZQ32M9V1B | FXZQ40M9V1B | FXZQ50M9V1B |
|--|----------------------------|----|--|-------------|-------------|-------------|-------------|
| Power Supply | Name | | V1 | | | | |
| | Phase | | 1~ | | | | |
| | Frequency | Hz | 50 | | | | |
| | Voltage | | V | 220-240 | | | |
| Current | Minimum circuit amps (MCA) | A | 0.8 | 0.8 | 0.8 | 0.8 | 0.9 |
| | Maximum fuse amps (MFA) | A | 15 | | | | |
| | Full load amps (FLA) | A | 0.6 | 0.6 | 0.6 | 0.6 | 0.7 |
| Voltage range | Minimum | V | -10% | | | | |
| | Maximum | V | +10% | | | | |
| Notes | | | Voltage range : units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits. | | | | |
| | | | Maximum allowable voltage range variation between phases is 2%. | | | | |
| | | | MCA/MFA : MCA = 1.25 x FLA | | | | |
| | | | MFA is smaller than or equal to 4 x FLA | | | | |
| | | | Next lower standard fuse rating minimum 15A | | | | |
| | | | Select wire size based on the MCA | | | | |
| Instead of a fuse, use a circuit breaker | | | | | | | |

2 Safety device settings

| | | FXZQ20M9 | FXZQ25M9 | FXZQ32M9 | FXZQ40M9 | FXZQ50M9 |
|-----------------------------|--|---|----------|----------|----------|----------|
| PC BOARD FUSE | | 250V 5A | | | | |
| FAN MOTOR THERMAL PROTECTOR | | °C OFF: 130 ^{±5} / ON: 80 ^{±20} | | | | |
| 3D006691K | | | | | | |

3 Options

FXZQ20-50

Options

| Item | Model | FXZQ20M9 | FXZQ25M9 | FXZQ32M9 | FXZQ40M9 | FXZQ50M9 |
|------|--|--------------------------|----------|-------------|----------|----------|
| 1 | Decoration panel | | | BYFQ60B | | |
| 2 | Sealing member of air discharge outlet | | | KDBH44BA60 | | |
| 3 | Panel spacer | | | KDBQ44B60 | | |
| 4 | Long-life filter | | | KAFQ441BA60 | | |
| 5 | Fresh air intake kit | Direct installation type | | KDDQ44XA60 | | |

Control System

| Item | Model | FXZQ20M9 | FXZQ25M9 | FXZQ32M9 | FXZQ40M9 | FXZQ50M9 |
|------|---|------------|------------|-----------|----------|----------|
| 1 | Remote control | Wireless | H/P | BRC7E530 | | |
| | | | C/O | BRC7E531 | | |
| | | Wired | For Europe | BRC1D52 | | |
| 2 | Central remote control | | | DCS302C51 | | |
| 2.1 | Electrical box with earth terminal (3 blocks) | | | KJB311A | | |
| 3 | Unified on/off controller | For Europe | | DCS301B51 | | |
| 3.1 | Electrical box with earth terminal (2 blocks) | | | KJB212A | | |
| 3.2 | Noise filter (for electromagnetic interface use only) | | | KEK28-1A | | |
| 4 | Schedule timer | | | DST301B51 | | |
| 5 | Adapter for wiring * | | | KRP1B57 | | |
| 6.1 | Wiring adapter for electrical appendices (1) (Note 2) | For Europe | | KRP2A52 | | |
| 6.2 | Wiring adapter for electrical appendices (2) (Note 2) | | | KRP4A53 | | |
| 7 | Installation box for adapter PCB | | | KRP1BA101 | | |
| 8 | Remote sensor | | | KRCS01-1 | | |
| 9 | External control adapter | For Europe | | DTA104A52 | | |
| 10 | Multi tenant (Note 3) | | | EKMTAC | | |

3TW31619-1

NOTES

- All options are supplied as kit
- The 'installation box for adapter PCB' is required.
- This kit contains parts to connect with 10 multi tenant indoor units.

4 Capacity tables

4 - 2 Heating capacity tables

| FXZQ-M9 | | | | | | | | | |
|-----------|------------------|------------------|--------|------------------------|------|------|------|------|------|
| Unit size | Nominal Capacity | Outdoor air temp | | Indoor air temp.: °CDB | | | | | |
| | | | | 16.0 | 18.0 | 20.0 | 21.0 | 22.0 | 24.0 |
| | | (°CDB) | (°CWB) | KW | KW | KW | KW | KW | KW |
| 20 | 2.5 | -19.8 | -20.0 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 |
| | | -18.8 | -19.0 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 |
| | | -16.7 | -17.0 | 1.6 | 1.6 | 1.6 | 1.6 | 1.6 | 1.6 |
| | | -14.7 | -15.0 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 |
| | | -12.6 | -13.0 | 1.8 | 1.8 | 1.8 | 1.8 | 1.8 | 1.8 |
| | | -10.5 | -11.0 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 |
| | | -9.5 | -10.0 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 |
| | | -8.5 | -9.1 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 |
| | | -7.0 | -7.6 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 |
| | | -5.0 | -5.6 | 2.1 | 2.1 | 2.1 | 2.1 | 2.1 | 2.1 |
| | | -3.0 | -3.7 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 |
| | | 0.0 | -0.7 | 2.3 | 2.3 | 2.3 | 2.3 | 2.3 | 2.3 |
| | | 3.0 | 2.2 | 2.5 | 2.5 | 2.4 | 2.4 | 2.3 | 2.2 |
| | | 5.0 | 4.1 | 2.5 | 2.5 | 2.5 | 2.4 | 2.3 | 2.2 |
| | | 7.0 | 6.0 | 2.6 | 2.6 | 2.5 | 2.4 | 2.3 | 2.2 |
| | | 9.0 | 7.9 | 2.7 | 2.7 | 2.5 | 2.4 | 2.3 | 2.2 |
| | | 11.0 | 9.8 | 2.8 | 2.7 | 2.5 | 2.4 | 2.3 | 2.2 |
| 13.0 | 11.8 | 2.8 | 2.7 | 2.5 | 2.4 | 2.3 | 2.2 | | |
| 15.0 | 13.7 | 2.8 | 2.7 | 2.5 | 2.4 | 2.3 | 2.2 | | |
| 25 | 3.2 | -19.8 | -20.0 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 |
| | | -18.8 | -19.0 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 |
| | | -16.7 | -17.0 | 2.1 | 2.1 | 2.0 | 2.0 | 2.0 | 2.0 |
| | | -14.7 | -15.0 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.1 |
| | | -12.6 | -13.0 | 2.3 | 2.3 | 2.3 | 2.3 | 2.3 | 2.3 |
| | | -10.5 | -11.0 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 |
| | | -9.5 | -10.0 | 2.5 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 |
| | | -8.5 | -9.1 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 |
| | | -7.0 | -7.6 | 2.6 | 2.6 | 2.6 | 2.6 | 2.6 | 2.6 |
| | | -5.0 | -5.6 | 2.7 | 2.7 | 2.7 | 2.7 | 2.7 | 2.7 |
| | | -3.0 | -3.7 | 2.8 | 2.8 | 2.8 | 2.8 | 2.8 | 2.8 |
| | | 0.0 | -0.7 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 2.8 |
| | | 3.0 | 2.2 | 3.1 | 3.1 | 3.1 | 3.1 | 3.0 | 2.8 |
| | | 5.0 | 4.1 | 3.3 | 3.2 | 3.2 | 3.1 | 3.0 | 2.8 |
| | | 7.0 | 6.0 | 3.4 | 3.4 | 3.2 | 3.1 | 3.0 | 2.8 |
| | | 9.0 | 7.9 | 3.5 | 3.4 | 3.2 | 3.1 | 3.0 | 2.8 |
| | | 11.0 | 9.8 | 3.6 | 3.4 | 3.2 | 3.1 | 3.0 | 2.8 |
| 13.0 | 11.8 | 3.6 | 3.4 | 3.2 | 3.1 | 3.0 | 2.8 | | |
| 15.0 | 13.7 | 3.6 | 3.4 | 3.2 | 3.1 | 3.0 | 2.8 | | |
| 32 | 4.0 | -19.8 | -20.0 | 2.4 | 2.4 | 2.3 | 2.3 | 2.3 | 2.3 |
| | | -18.8 | -19.0 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 |
| | | -16.7 | -17.0 | 2.6 | 2.6 | 2.6 | 2.6 | 2.6 | 2.5 |
| | | -14.7 | -15.0 | 2.7 | 2.7 | 2.7 | 2.7 | 2.7 | 2.7 |
| | | -12.6 | -13.0 | 2.9 | 2.8 | 2.8 | 2.8 | 2.8 | 2.8 |
| | | -10.5 | -11.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 |
| | | -9.5 | -10.0 | 3.1 | 3.1 | 3.1 | 3.1 | 3.0 | 3.0 |
| | | -8.5 | -9.1 | 3.1 | 3.1 | 3.1 | 3.1 | 3.1 | 3.1 |
| | | -7.0 | -7.6 | 3.2 | 3.2 | 3.2 | 3.2 | 3.2 | 3.2 |
| | | -5.0 | -5.6 | 3.4 | 3.4 | 3.4 | 3.4 | 3.4 | 3.4 |
| | | -3.0 | -3.7 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 |
| | | 0.0 | -0.7 | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 | 3.5 |
| | | 3.0 | 2.2 | 3.9 | 3.9 | 3.9 | 3.9 | 3.7 | 3.5 |
| | | 5.0 | 4.1 | 4.1 | 4.1 | 4.0 | 3.9 | 3.7 | 3.5 |
| | | 7.0 | 6.0 | 4.2 | 4.2 | 4.0 | 3.9 | 3.7 | 3.5 |
| | | 9.0 | 7.9 | 4.3 | 4.3 | 4.0 | 3.9 | 3.7 | 3.5 |
| | | 11.0 | 9.8 | 4.5 | 4.3 | 4.0 | 3.9 | 3.7 | 3.5 |
| 13.0 | 11.8 | 4.5 | 4.3 | 4.0 | 3.9 | 3.7 | 3.5 | | |
| 15.0 | 13.7 | 4.5 | 4.3 | 4.0 | 3.9 | 3.7 | 3.5 | | |
| 40 | 5.0 | -19.8 | -20.0 | 3.0 | 2.9 | 2.9 | 2.9 | 2.9 | 2.9 |
| | | -18.8 | -19.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 |
| | | -16.7 | -17.0 | 3.2 | 3.2 | 3.2 | 3.2 | 3.2 | 3.2 |
| | | -14.7 | -15.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.4 | 3.4 |
| | | -12.6 | -13.0 | 3.6 | 3.6 | 3.6 | 3.5 | 3.5 | 3.4 |
| | | -10.5 | -11.0 | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 |
| | | -9.5 | -10.0 | 3.8 | 3.8 | 3.8 | 3.8 | 3.8 | 3.8 |
| | | -8.5 | -9.1 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 |
| | | -7.0 | -7.6 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 |
| | | -5.0 | -5.6 | 4.2 | 4.2 | 4.2 | 4.2 | 4.2 | 4.2 |
| | | -3.0 | -3.7 | 4.4 | 4.4 | 4.4 | 4.4 | 4.4 | 4.4 |
| | | 0.0 | -0.7 | 4.7 | 4.6 | 4.6 | 4.6 | 4.6 | 4.4 |
| | | 3.0 | 2.2 | 4.9 | 4.9 | 4.9 | 4.8 | 4.7 | 4.4 |
| | | 5.0 | 4.1 | 5.1 | 5.1 | 5.0 | 4.8 | 4.7 | 4.4 |
| | | 7.0 | 6.0 | 5.2 | 5.2 | 5.0 | 4.8 | 4.7 | 4.4 |
| | | 9.0 | 7.9 | 5.4 | 5.3 | 5.0 | 4.8 | 4.7 | 4.4 |
| | | 11.0 | 9.8 | 5.6 | 5.3 | 5.0 | 4.8 | 4.7 | 4.4 |
| 13.0 | 11.8 | 5.6 | 5.3 | 5.0 | 4.8 | 4.7 | 4.4 | | |
| 15.0 | 13.7 | 5.6 | 5.3 | 5.0 | 4.8 | 4.7 | 4.4 | | |
| 50 | 6.3 | -19.8 | -20.0 | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 |
| | | -18.8 | -19.0 | 3.8 | 3.8 | 3.8 | 3.8 | 3.8 | 3.8 |
| | | -16.7 | -17.0 | 4.1 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 |
| | | -14.7 | -15.0 | 4.3 | 4.3 | 4.3 | 4.2 | 4.2 | 4.2 |
| | | -12.6 | -13.0 | 4.5 | 4.5 | 4.5 | 4.5 | 4.5 | 4.5 |
| | | -10.5 | -11.0 | 4.7 | 4.7 | 4.7 | 4.7 | 4.7 | 4.7 |
| | | -9.5 | -10.0 | 4.8 | 4.8 | 4.8 | 4.8 | 4.8 | 4.8 |
| | | -8.5 | -9.1 | 4.9 | 4.9 | 4.9 | 4.9 | 4.9 | 4.9 |
| | | -7.0 | -7.6 | 5.1 | 5.1 | 5.1 | 5.1 | 5.1 | 5.1 |
| | | -5.0 | -5.6 | 5.3 | 5.3 | 5.3 | 5.3 | 5.3 | 5.3 |
| | | -3.0 | -3.7 | 5.5 | 5.5 | 5.5 | 5.5 | 5.5 | 5.5 |
| | | 0.0 | -0.7 | 5.9 | 5.9 | 5.8 | 5.8 | 5.8 | 5.5 |
| | | 3.0 | 2.2 | 6.2 | 6.2 | 6.2 | 6.1 | 5.9 | 5.5 |
| | | 5.0 | 4.1 | 6.4 | 6.4 | 6.3 | 6.1 | 5.9 | 5.5 |
| | | 7.0 | 6.0 | 6.6 | 6.6 | 6.3 | 6.1 | 5.9 | 5.5 |
| | | 9.0 | 7.9 | 6.8 | 6.7 | 6.3 | 6.1 | 5.9 | 5.5 |
| | | 11.0 | 9.8 | 7.0 | 6.7 | 6.3 | 6.1 | 5.9 | 5.5 |
| 13.0 | 11.8 | 7.1 | 6.7 | 6.3 | 6.1 | 5.9 | 5.5 | | |
| 15.0 | 13.7 | 7.1 | 6.7 | 6.3 | 6.1 | 5.9 | 5.5 | | |

3TW25512-2A

5 Dimensional drawing & centre of gravity

5 - 1 Dimensional drawing

FXZQ-M9

• Decoration panel
BYFQ60B7W1 White Ral 9010

| Nr | Part name | Description |
|----|-----------------------------|------------------------|
| 1 | Liquid pipe connection | ø6.4 Flare connection |
| 2 | Gas pipe connection | ø12.7 Flare connection |
| 3 | Drain pipe connection | VP25 (O.D. ø32) |
| 4 | Wire intake | |
| 5 | Interunit wiring connection | |
| 6 | Grounding terminal | Inside switch box (M4) |
| 7 | Discharge | |
| 8 | Air suction grille | |
| 9 | Long life filter | |
| 10 | Suspension bolt | |

NOTES

- Location of manufacturer's label
Indoor unit: on the bell mouth, inside suction panel
Decoration panel: on the inner frame, inside suction grille
When using an infrared remote control, this position will be a signal receiver. Refer to the drawing of the infrared remote control for more details
- When the temperature and humidity in the ceiling exceed 30°C and RH is 80%, or the fresh air is inducted into the ceiling, or the unit continues 24 hour operation, an additional insulation is required (thickness 10mm or more or glass wool or polyethylene foam)
- Though the installation is acceptable up to maximum 660mm square ceiling opening, keep the clearance of 45mm or less between the main unit and the ceiling opening so that the panel overlap allowance can be ensured.

3D039005B

FXZQ-M9


| Nr | Name | Description |
|----|------------------|-------------|
| 1 | Indoor unit | |
| 2 | Decoration panel | |
| 3 | Panel spacer | |

15 Dimension between the bottom surface of indoor unit and the surface of ceiling
40 Thickness of panel spacer


3D041038

5 Dimensional drawing & centre of gravity

5 - 2 Centre of gravity

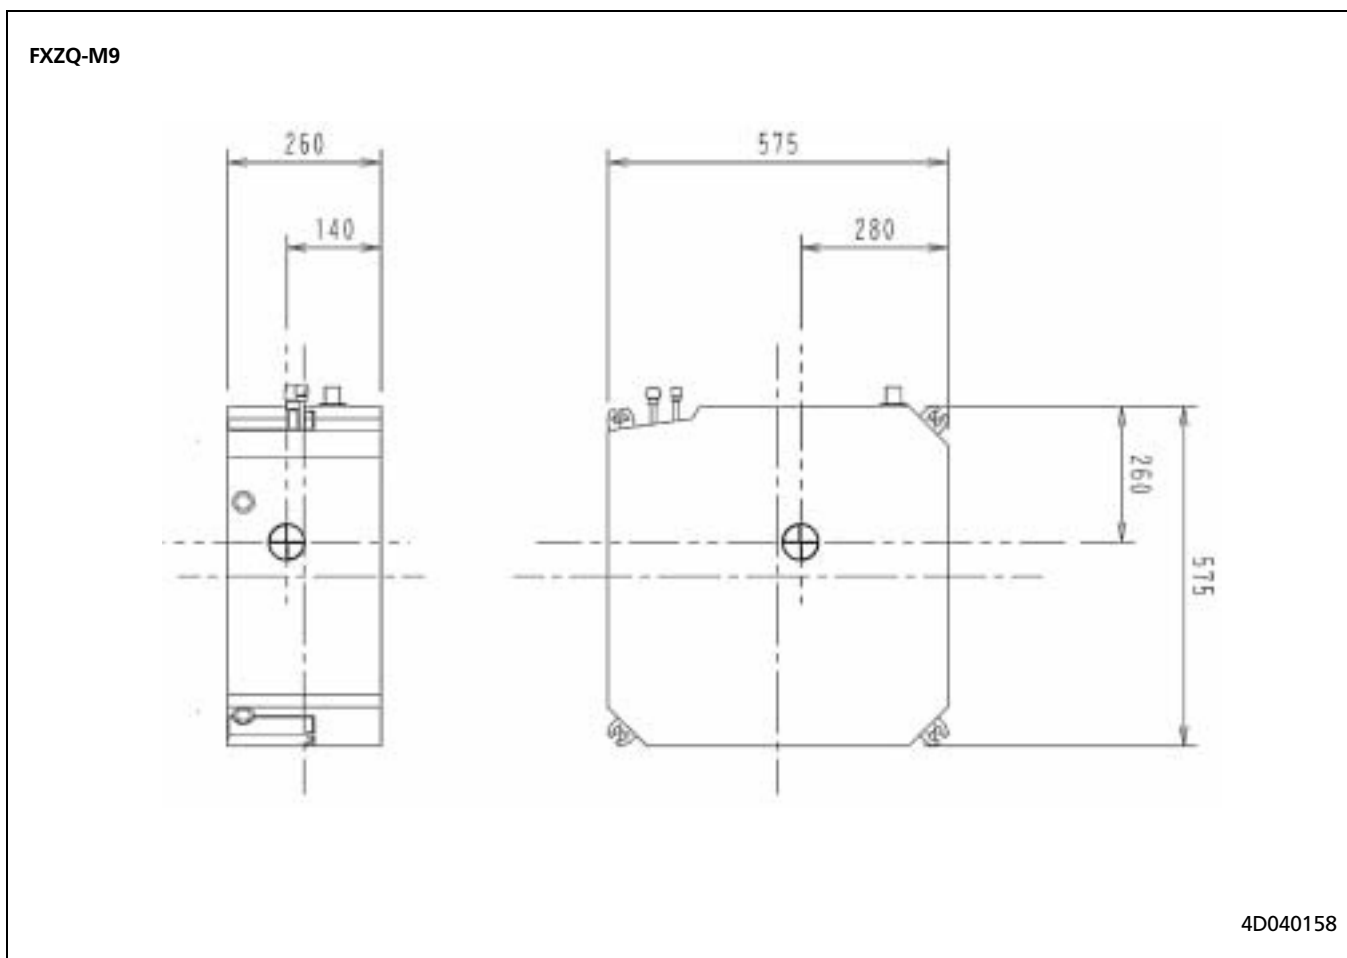


6 Piping diagram

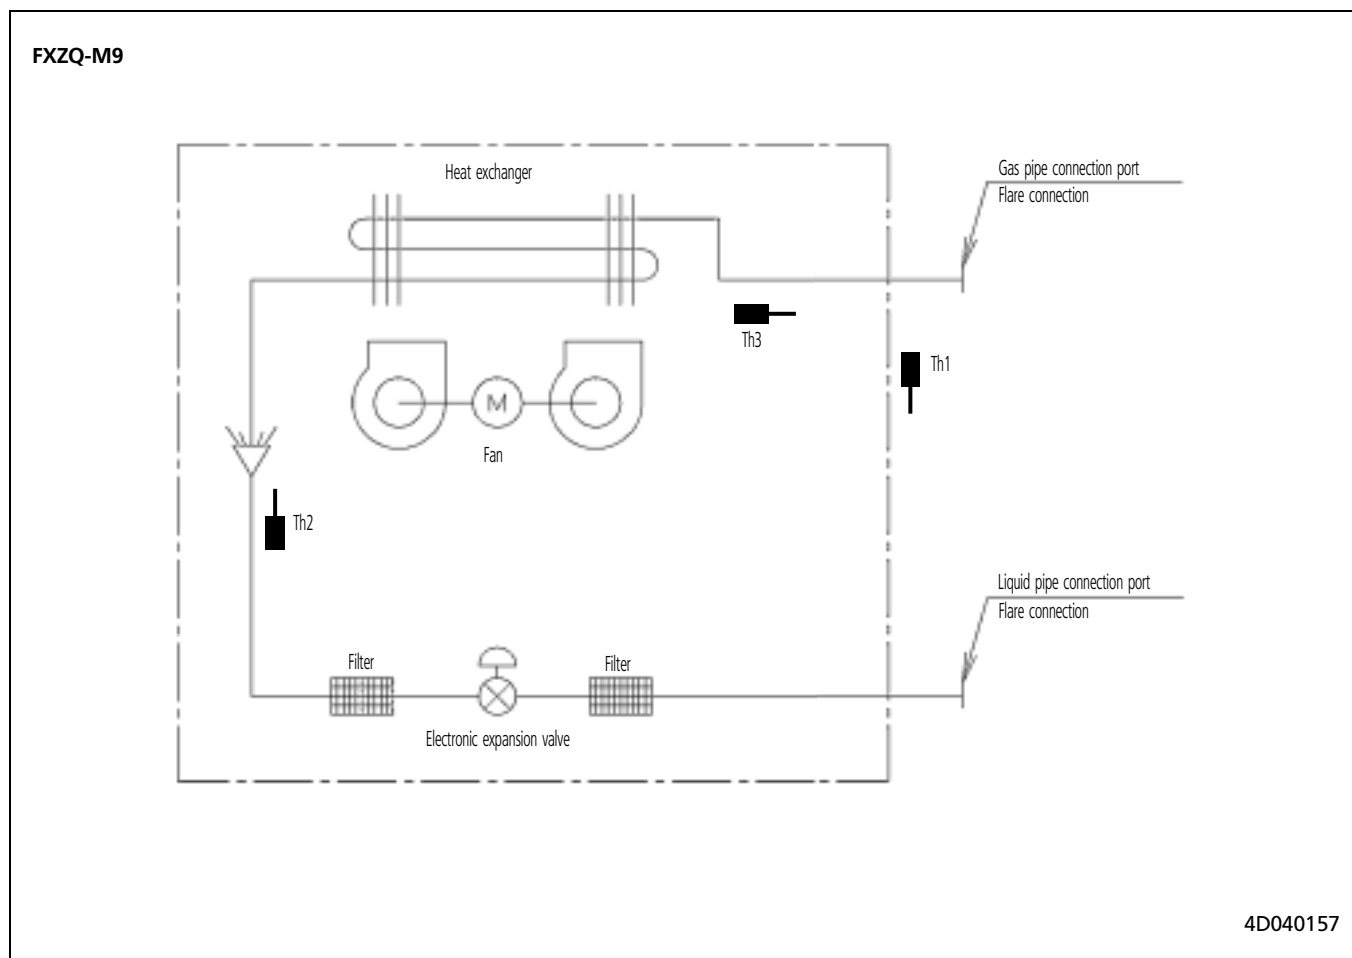

7 Wiring diagram

7 - 1 Wiring diagram

FXZQ-M9

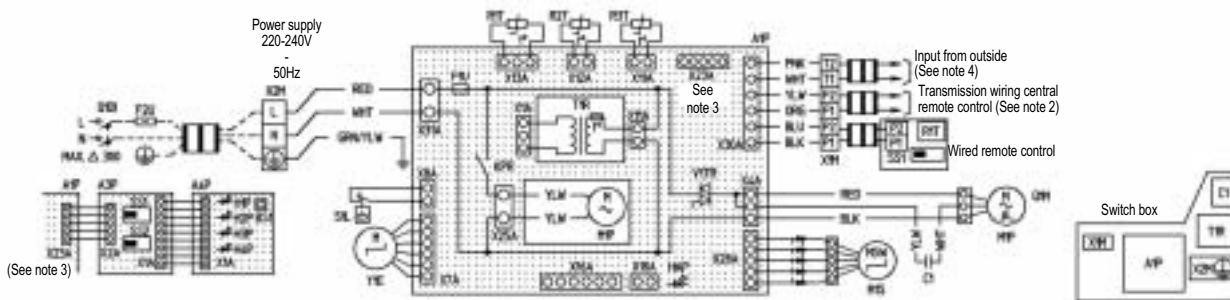

| | | | | | |
|------|--|---|----------------------------|------------------------------|---|
| A1P | Printed circuit board | R2T | Thermistor (coil-liquid) | BS1 | Push button (on/off) |
| C1 | Capacitor (M1F) | R3T | Transformer (220-240V/22V) | H1P | Light emitting diode (on-red) |
| F1U | Fuse(B , 5a, 250V) | V1TR | Triac | H2P | Light emitting diode (timer-green) |
| F2U | Field fuse | X1M | Terminal strip | H2P | Light emitting diode (filter sign-red) |
| HAP | Light emitting diode (service monitor green) | X2M | Terminal strip | H3P | Light emitting diode (defrost-orange) |
| KPR | Magnetic relay (M1P) | Y3E | Electronic expansion valve | SS1 | Selector switch (main/sub) |
| M1F | Motor (indoor fan) | Wired remote control | | SS2 | Selector switch (wireless address set) |
| M1P | Motor (drain pump) | R1T | Thermistor (air) | connector for optional parts | |
| M1S | Motor (swing flap) | SS1 | Selector switch (main/sub) | X16A | Connector (adapter for wire) |
| Q1DI | Field earth leak dedector (max. 300mA) | Infrared remote control (receiver/display unit) | | X18A | Connector (on/off) (wiring adapter for electrical appendices) |
| Q1M | Therminal protector (M1F embedded) | A3P | Printed circuit board | | |
| R1T | Thermistor (air) | A4P | Printed circuit board | | |

□ □ : Terminal
 □ □ : Connector
 ○ — : Wire clamp
 — — : Field wiring

Colors: RED Red PNK pink
 BLK Black ORG Orange
 WHT White GRN Green
 YLW Yellow BLU Blue

3TW26426-1B


NOTES

- 1 In case of using a remote control, connect it to unit in accordance to the attached installation manual.
- 2 X23A is connected when the wireless remote control kit is being used.
- 3 When connecting the input wires from outside, forced on or on/off control operation can be selected by remote control. In details, refer to the installation manual attached the unit.
- 4 Remote control model varies according to the combination system. See technical data and catalogs. Etc. before connecting.

8 Sound data

8 - 1 Sound level data

FXZQ-M9





| Model | Sound pressure level | | Measuring location | Sound power level |
|----------|----------------------|----|---|-------------------|
| | H | L | | |
| FXZQ20M9 | 30 | 25 |  | 47 |
| FXZQ25M9 | 30 | 25 | | 47 |
| FXZQ32M9 | 32 | 26 | | 49 |
| FXZQ40M9 | 36 | 28 | | 53 |
| FXZQ50M9 | 41 | 33 | | 58 |

NOTES

- 1 Measuring place: anechoic chamber
- 2 Operation noise differs with operation and ambient conditions
- 3 Operating conditions: Power source: 230V, 50 Hz
 - Cooling: Indoor air temperature: 27°CDB, 19°CWB
Outdoor air temperature: 35°CDB, 24°CWB
 - Heating: Indoor air temperature: 20°CDB, 15°CWB
Outdoor air temperature: 7°CDB, 6°CWB

8 Sound data

8 - 2 Sound pressure spectrum

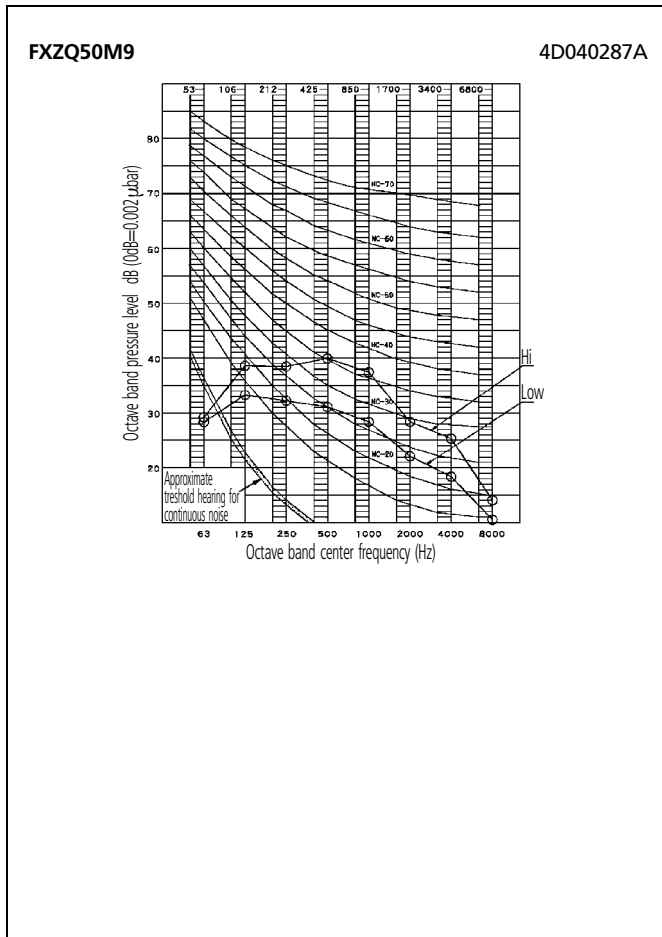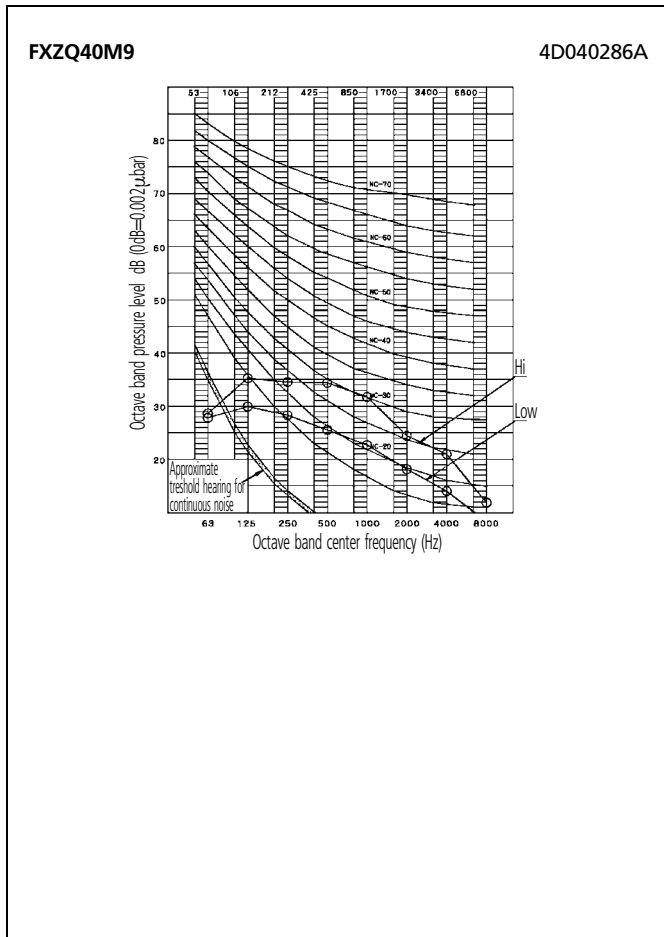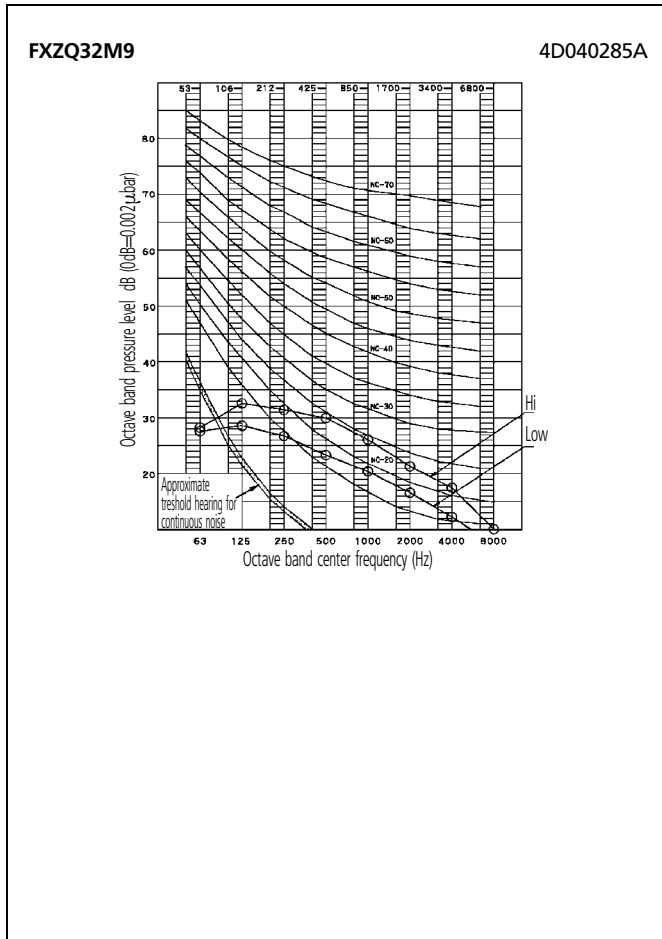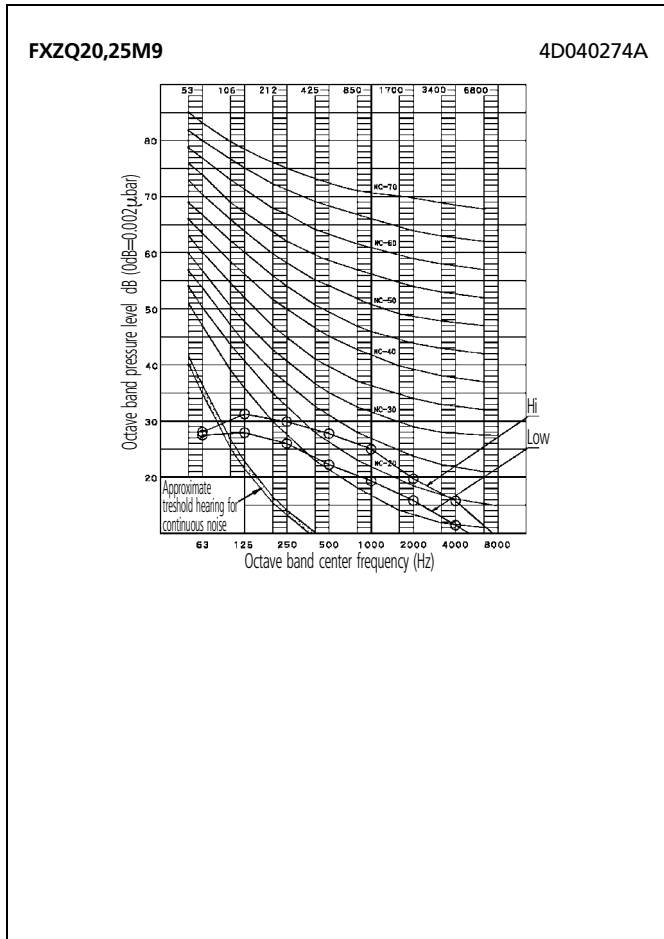


9 Air flow pattern

FXZQ20,25M9


Cooling air velocity distribution

4-way discharge, air flow direction: horizontal

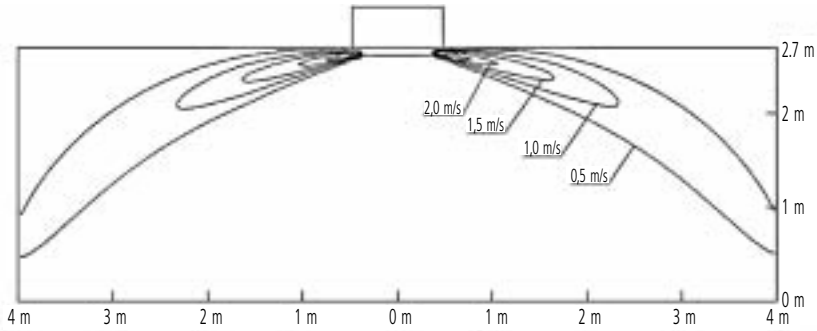

Cooling air temperature distribution

4-way discharge, air flow direction: horizontal

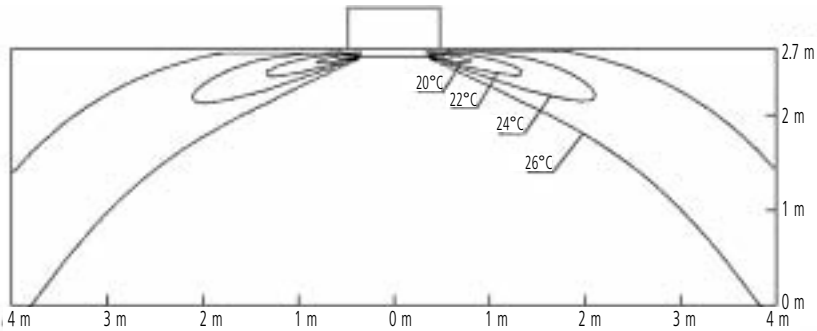


4D039738A

FXZQ32M9


Cooling air velocity distribution

4-way discharge, air flow direction: horizontal

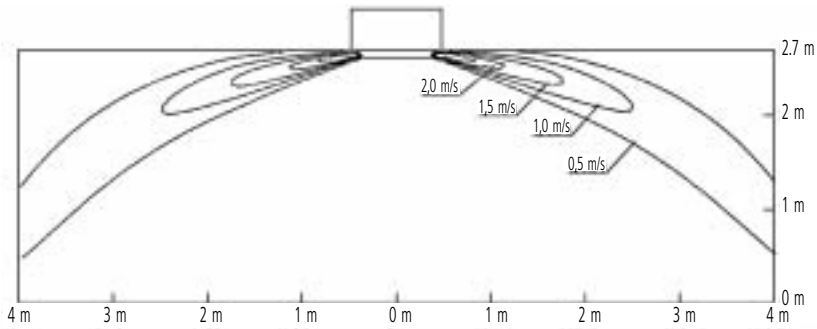

Cooling air temperature distribution

4-way discharge, air flow direction: horizontal

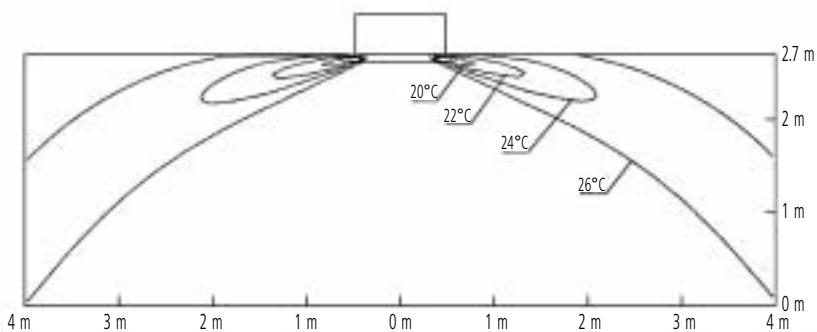


4D040188

9 Air flow pattern

FXZQ40M9


Cooling air velocity distribution

4-way discharge, air flow direction: horizontal

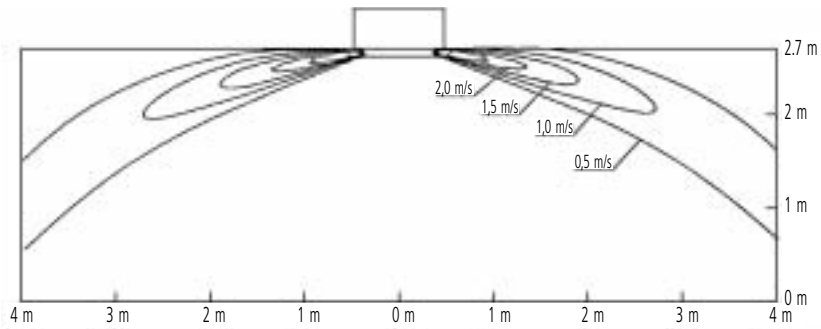

Cooling air temperature distribution

4-way discharge, air flow direction: horizontal

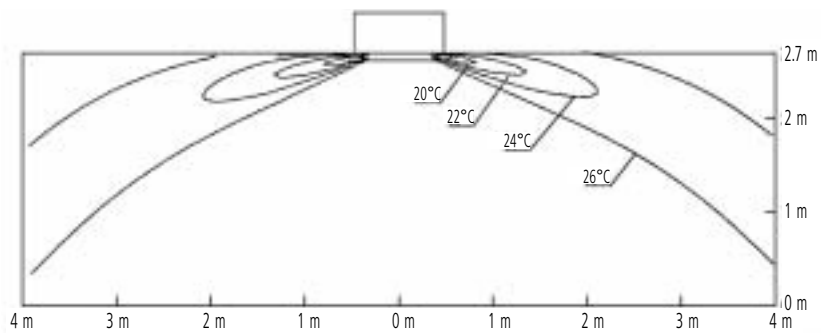


4D040189

FXZQ50M9


Cooling air velocity distribution

4-way discharge, air flow direction: horizontal

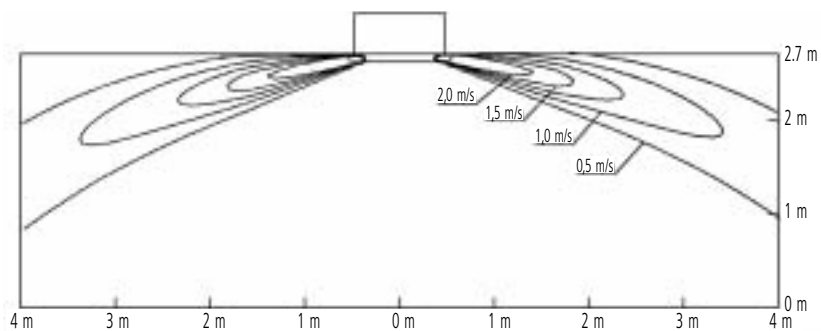

Cooling air temperature distribution

4-way discharge, air flow direction: horizontal

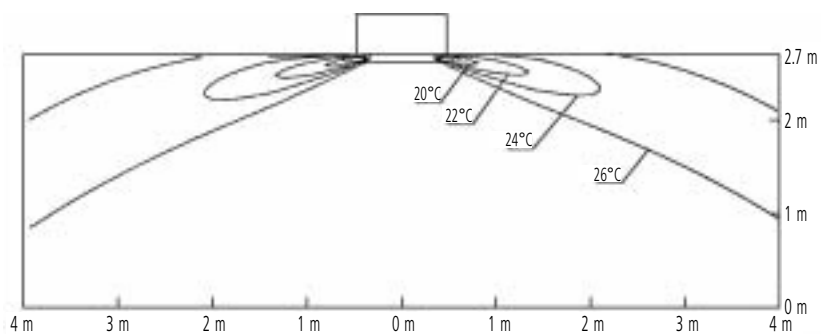


4D040190

9 Air flow pattern

FXZQ20,25M9


Heating air velocity distribution

4-way discharge, air flow direction: down

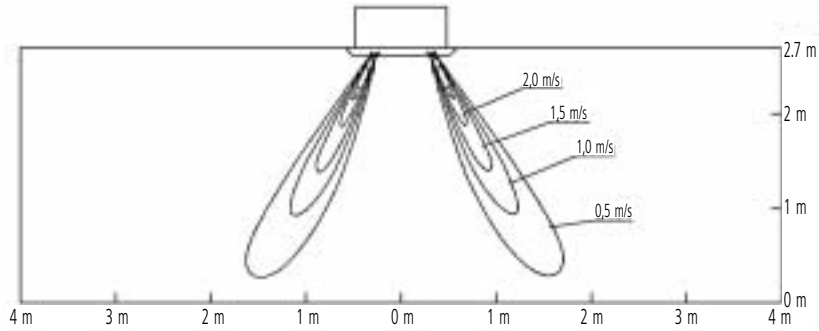

Heating air temperature distribution

4-way discharge, air flow direction: down

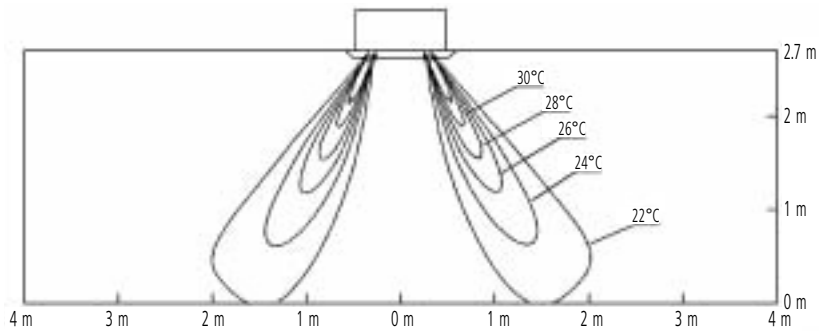


4D039820A

FXZQ32M9


Heating air velocity distribution

4-way discharge, air flow direction: down

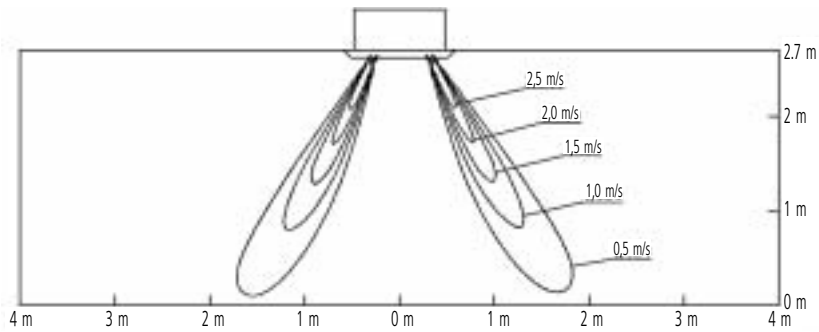

Heating air temperature distribution

4-way discharge, air flow direction: down

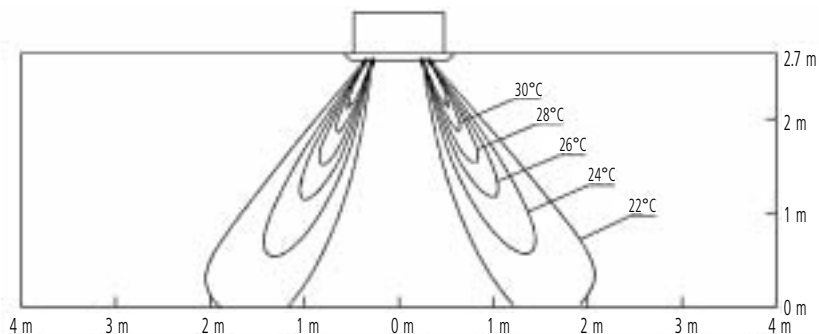


4D040191

9 Air flow pattern

FXZQ40M9


Heating air velocity distribution

4-way discharge, air flow direction: down

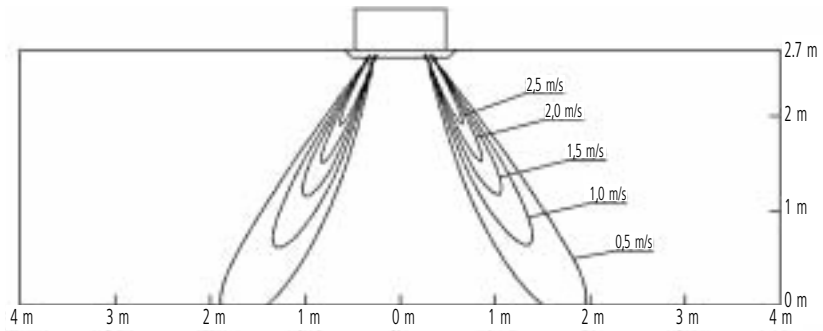

Heating air temperature distribution

4-way discharge, air flow direction: down

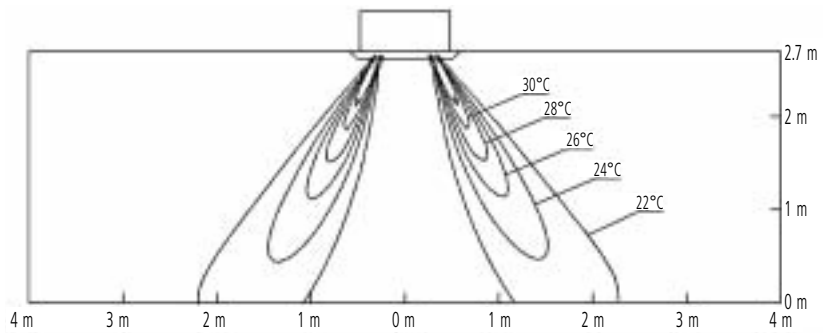


4D040192

FXZQ50M9


Heating air velocity distribution

4-way discharge, air flow direction: down

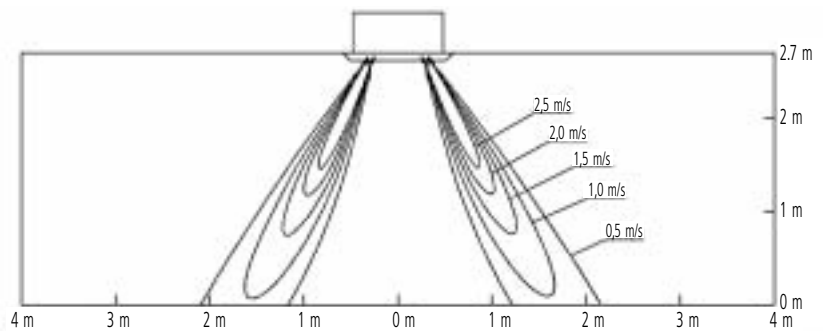

Heating air temperature distribution

4-way discharge, air flow direction: down

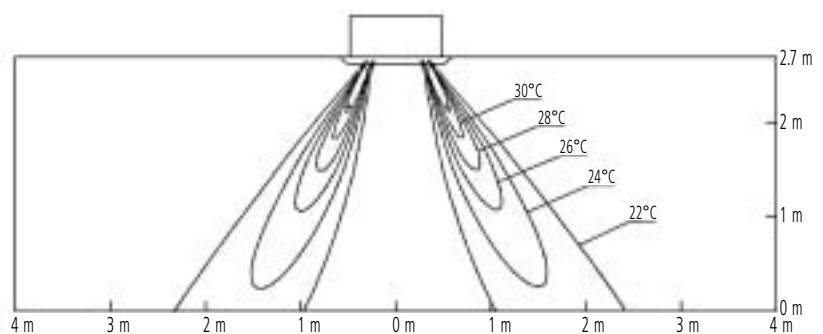

4D040193



Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intension to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



Daikin Europe N.V. is approved by LRQA for its Quality Management System in accordance with the ISO9001 standard. ISO9001 pertains to quality assurance regarding design, development, manufacturing as well as to services related to the product.




ISO14001 assures an effective environmental management system in order to help protect human health and the environment from the potential impact of our activities, products and services and to assist in maintaining and improving the quality of the environment.



Daikin units comply with the European regulations that guarantee the safety of the product.

The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V..



DAIKIN EUROPE N.V.

Naamloze Vennootschap
Zandvoordestraat 300
B-8400 Oostende, Belgium
www.daikin.eu
BTW: BE 0412 120 336
RPR Oostende

VRV® products are not within the scope of the Eurovent certification programme.